

**The Philadelphia Parking Authority
701 Market Street, Suite 5400
Philadelphia, PA 19106**

**RFP No. 23-19
Emergency Generator Replacement at Olde City
Addendum Two**

To: See Email Distribution List

From: Shannon Stewart
Manager of Contract Administration

Date: January 25, 2024

No Pages: 1 plus Appendix A

This addendum is issued on January 25, 2024, prior to the proposal due date to add, delete, modify, clarify and/or to respond to questions submitted by prospective offerors regarding the work included in the above referenced solicitation.

CHANGES TO THE RFP DOCUMENT

- 1. Proposal Due Date:** The Proposal Due Date has been extended to Tuesday, February 6, 2024 at 12:00 PM.
- 2. Work Statement:** The following language has been added to the Work Statement. Please see Appendix A for photographs of the existing automatic transfer switch:

Offerors will be responsible for replacing the existing automatic transfer switch. Offerors must indicate the specifications of the automatic transfer switch included in their proposal in Tab D. Any costs associated with the automatic transfer switch, including but not limited to any installation and parts, must be included in the cost of the generator.

END OF ADDENDUM TWO

RFP No. 23-19

Addendum # 2 - Appendix A

Automatic Transfer Switch Photographs



CARR & DUFF
ELECTRICAL MAINTENANCE
24 HOUR EMERGENCY SERVICE
1000 W. 10TH ST.
DENVER, CO 80202


KOHLER


100

CARR & DUFF
ELECTRICAL MAINTENANCE
24 HOUR EMERGENCY SERVICE
1000 W. 10TH ST.
DENVER, CO 80202

1000 W. 10TH ST.
DENVER, CO 80202

CARR & DUFF
ELECTRICAL MAINTENANCE
24 HOUR EMERGENCY SERVICE
1000 W. 10TH ST.
DENVER, CO 80202

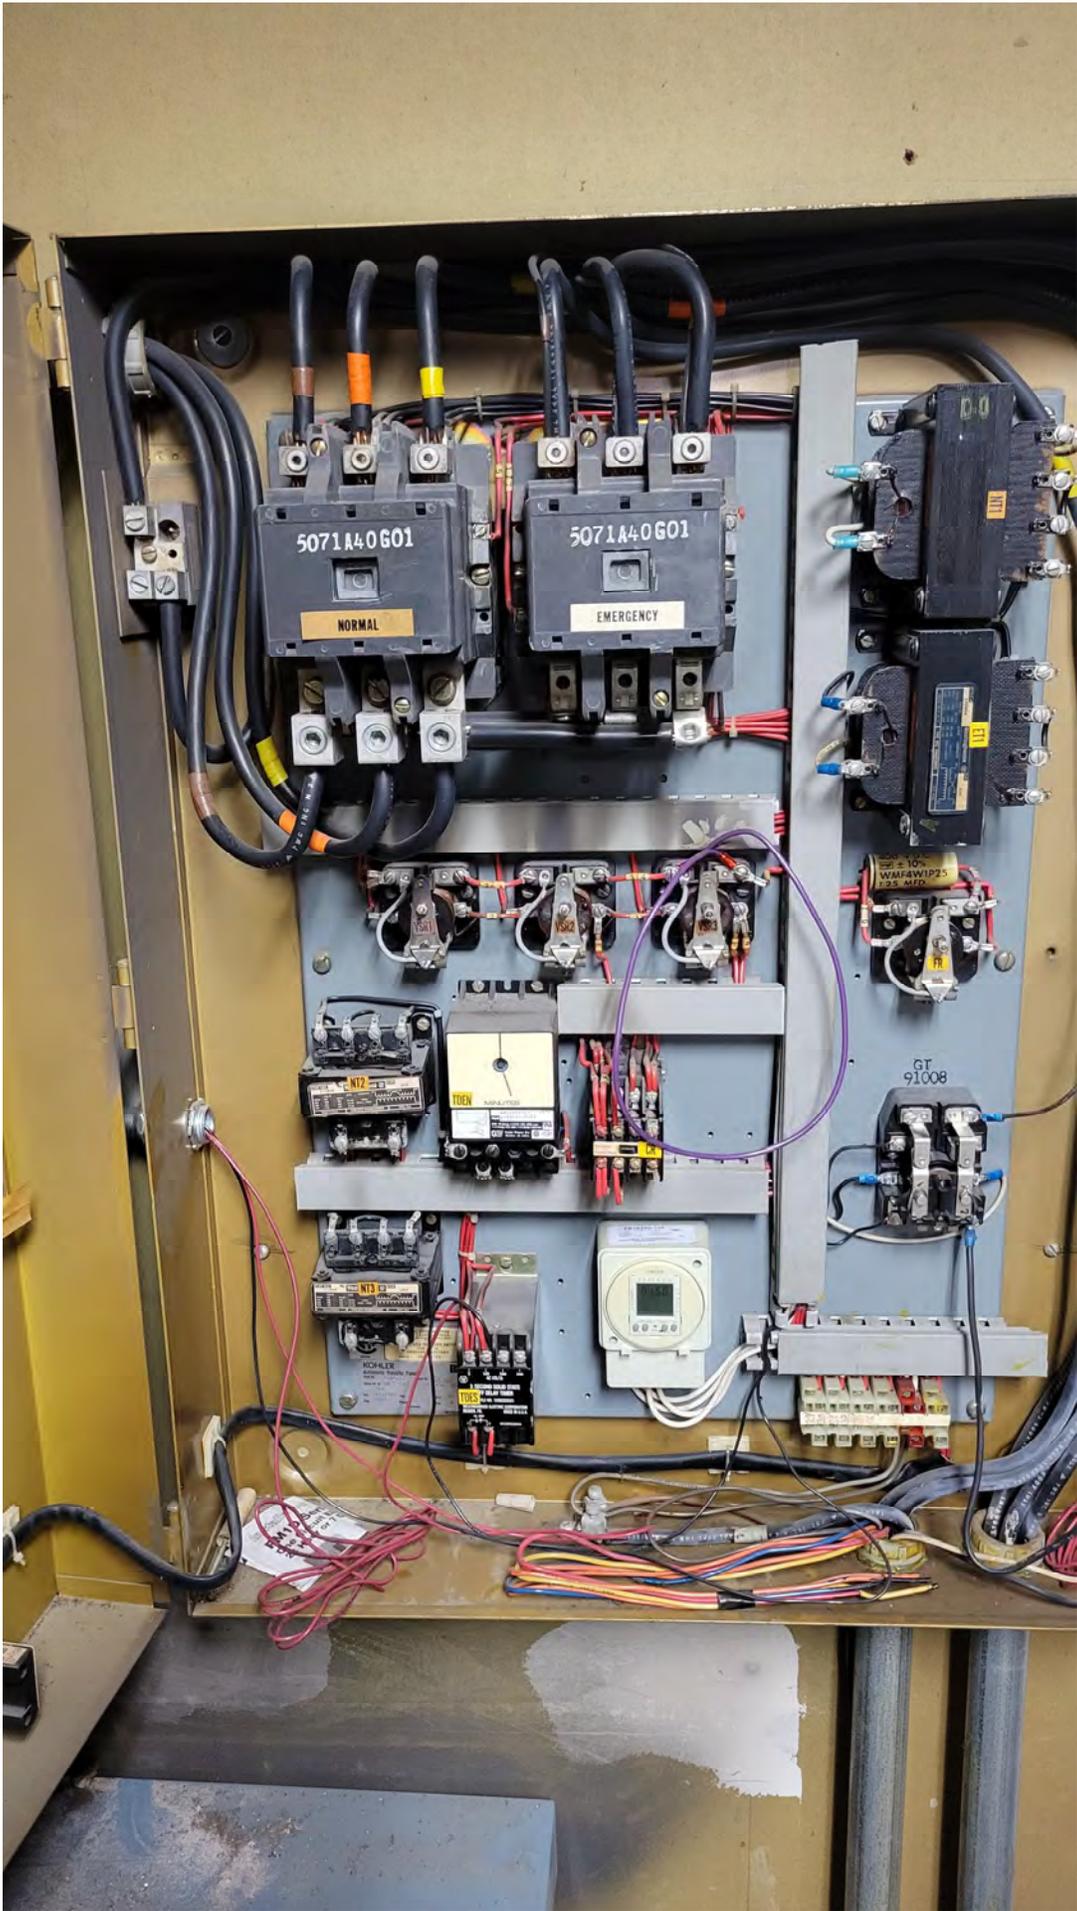

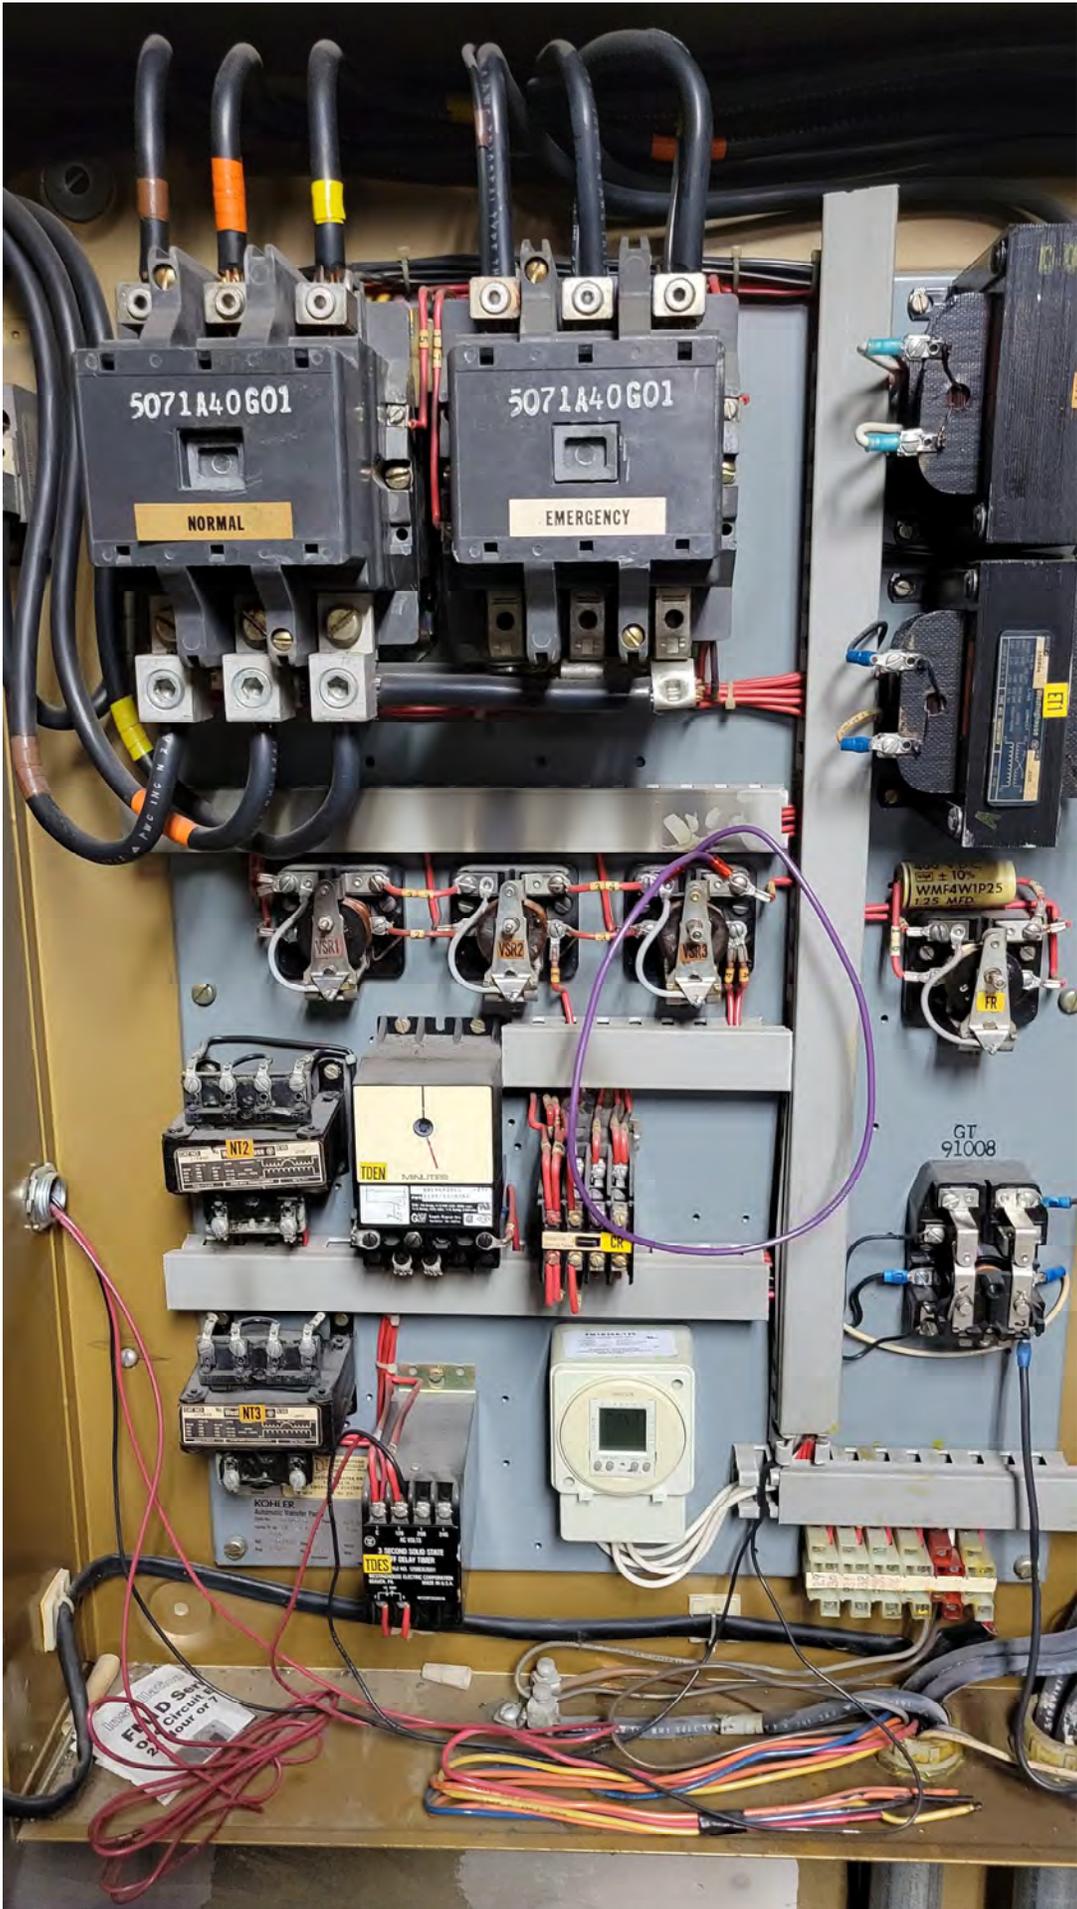

5071A40G01

NORMAL

5071A40G01

EMERGENCY

VSR1

VSR2

VSR3

NT2

TDEN

GT 91008

NT3

TD8S

10 Amp
120 Volt
15000 BTU
1/2" Dia
1/4" Thick
1/2" Hole
1/2" Dia
1/4" Thick
1/2" Hole

WMF4W1P25
1.25 MED